



To an additional three 865 Notification Circuit Modules. Up to a maximum of five 865 modules on the XR5 panels. Modules must be installed in a Model 348F, 340SL, 349, or 350 enclosure connected by no more than 20 feet of conduit.

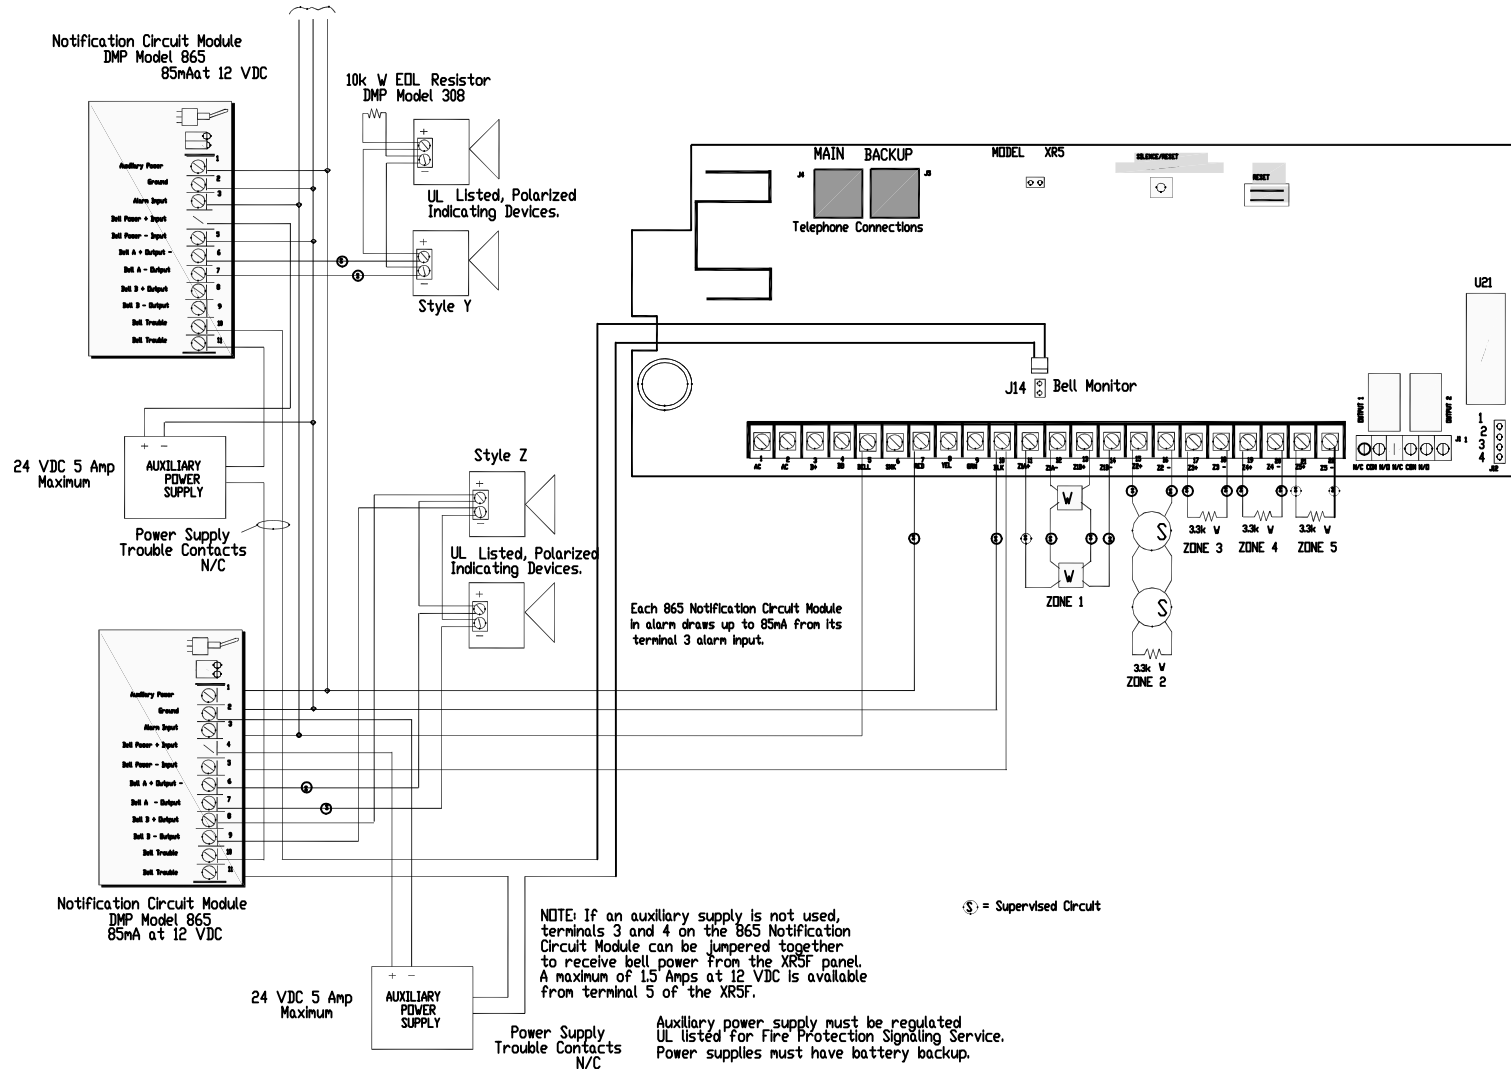

NOTE: If an auxiliary supply is not used, terminals 3 and 4 on the 865 Notification Circuit Module can be jumpered together to receive bell power from the XR5F panel. A maximum of 1.5 Amps at 12 VDC is available from terminal 5 of the XR5F.

Auxiliary power supply must be regulated UL listed for Fire Protection Signaling Service. Power supplies must have battery backup.

(S) = Supervised Circuit

Architects and Engineers CAD Drawings		 Digital Monitoring Products 2841 E. Industrial, Springfield, MO 65802	
FILE NAME		TITLE	
DRAWN	DATE	XR5, 865 Wiring	
CHECKED	SCALE	PART NO.	REV.
APPR'VD	SHEET 1 OF 1		