


DMP transformer
Model 320
16.5 VAC 40VA
wire-in


Secondary Power Supply
12 Amps max. charging current.
Use only 12 VDC rechargeable
batteries. DMP Model 367.
Replace every 3 to 5 years.

Bell Circuit
1.5 Amps at 12 VDC
Minimum cutoff time 5
minutes.

Model 866
Class B (Style W)
Notification Circuit Module
37mA at 12 VDC

All modules must be
installed in an approved
enclosure within 20 feet and
connected by conduit.

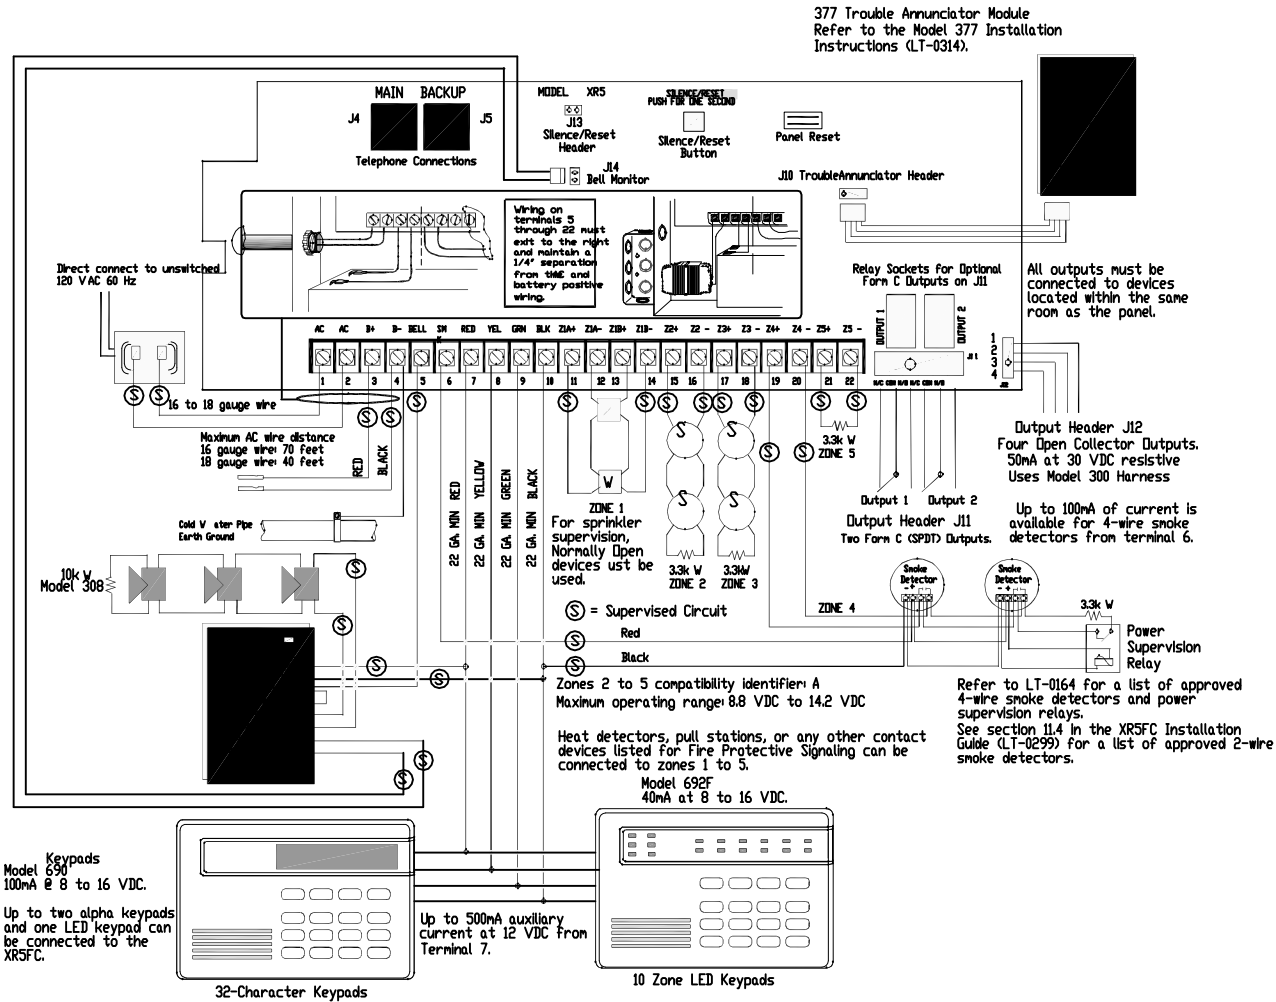

Architects and Engineers CAD Drawings		 Digital Monitoring Products 2841 E. Industrial, Springfield, MO 65802	
FILE NAME		TITLE	
DRAWN LK	DATE 9/24/2007	XR5FC Wiring	
CHECKED	SCALE NTS	PART NO.	REV.
APPR'VD	SHEET 1 OF 1		