

ENCRYPTED CELLULAR COMMUNICATIONS FOR SECURE COMPARTMENTED INFORMATION FACILITY

Installation Sheet

ENCRYPTED CELLULAR COMMUNICATIONS TRANSMITTER INSTALLATION

When the transmitter and its associated antenna are installed in a metal enclosure the minimum separation distance from the classified component to the transmitter is 39 inches.

⚡ Caution: Use of cellular technologies must be coordinated with and approved by the Authorizing Official (AO) prior to installation.

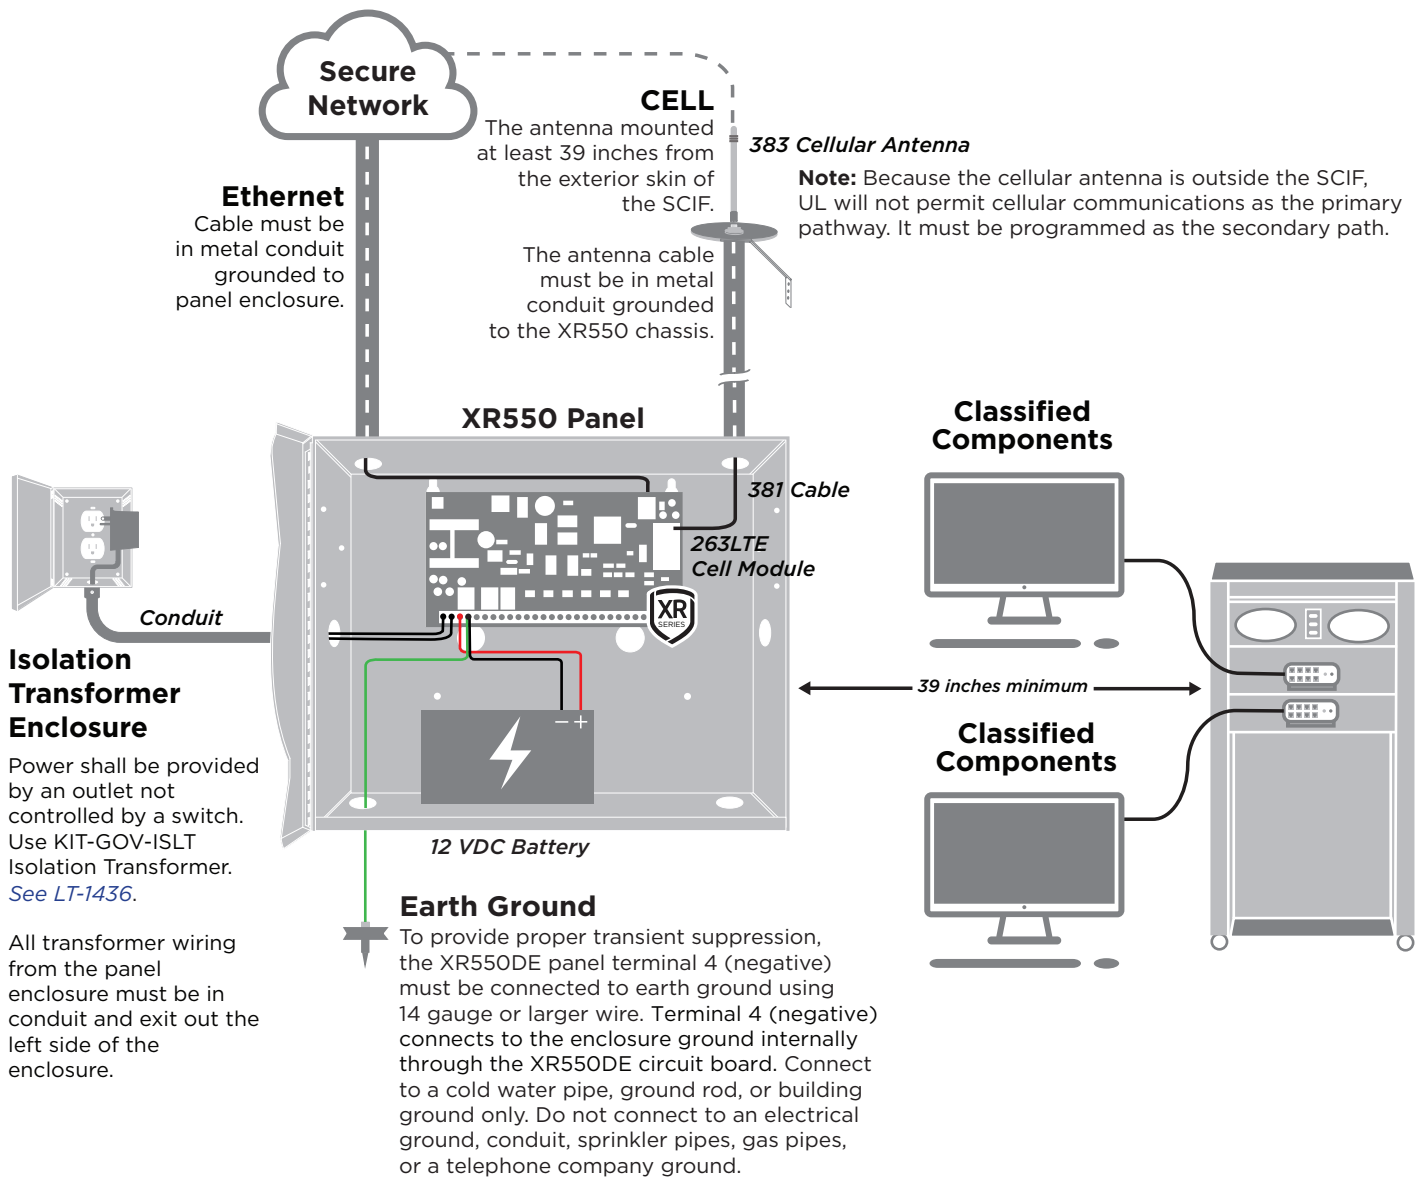


Figure 1: SCIF Setup Diagram